


RFQ 2FY20 Vendor Question 24

1. Civil plans do not show location of primary power supply/transformer(s). Without the location of the primary power supply to each building we cannot determine length of run for secondary power supply. Please provide transformer/primary power supply location for each building or length of secondary power supply run to be included in bid for each building?

Please see approximate location of transformer below.

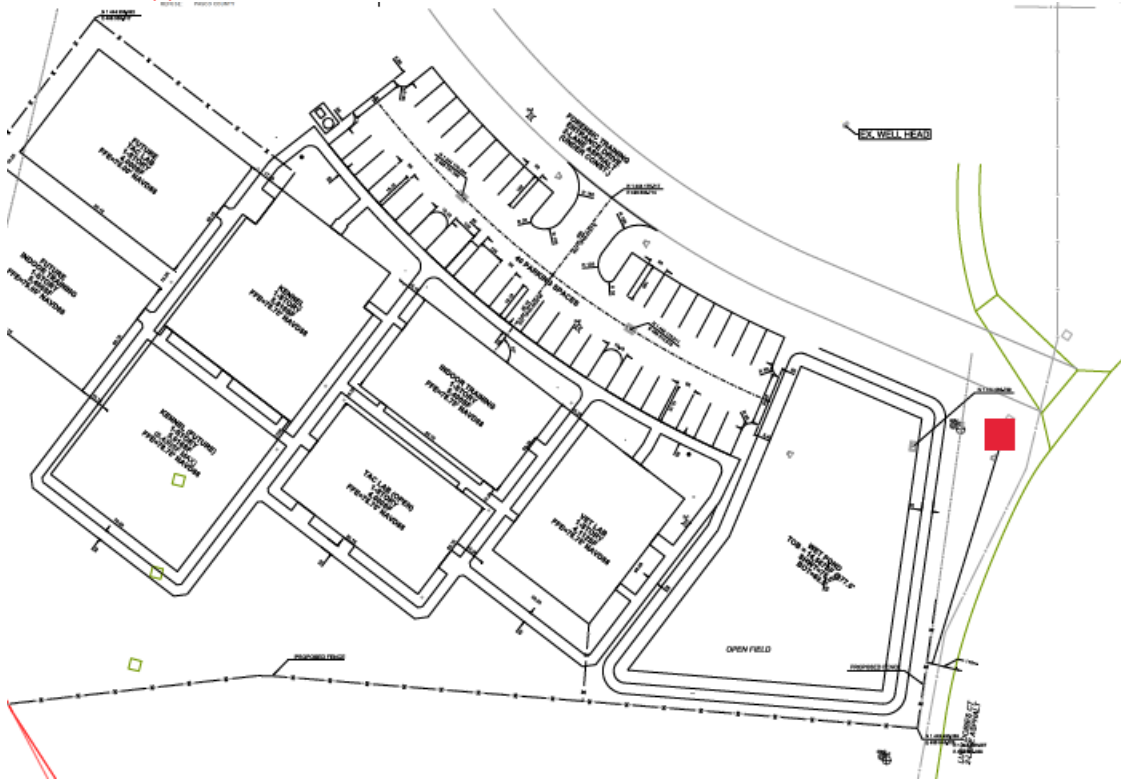

2. Kennel building does not show any data outlets? Are we to include empty conduit stubs for data outlet/drop locations?

Data outlets for kennel will be in office only. We will need data lines for WAP for wifi throughout the entire building though.

3. Indoor Training and the Kennel buildings appear to show Emergency Light Fixtures on the exterior of the building?

The lighting shown is exterior flood lighting.

4. The Kennel Bank (108, 109) and Outdoor Dog Run (110, 111) light fixtures are not weatherproof?

These fixtures are to be weatherproof / weather rated fixtures.